



Test Certification

14812 Hunter Lane
Midway City CA 92655
Phone: 714 450-5929 Fax: 714 829-3103

Serial Number	20030281-6
Test Date	8/4/2022
Record No	1937
P.O. Number	DONNA ANDERSON
Work Order No.	1108

Page 1 of 1

Bill to Customer SE-0070692

Site Customer SE-0055383

Inframark Water Infrastructure Operation
1600 Avalon Parkway
Perris CA 92571

Inframark Water (Well # 1)
1600 Avalon Parkway
Perris CA 92571

Flow Meter Totalizer Reading - Gallons

Site Location

Before Test Flow Meter 160042 x 1000

Prover No

Well # 1

After Test Flow Meter 160045 x 1000

PT-001

Meter Manufacture Size and Model

Service Type

Test Cycle

Pipe Diameter

Pipe Area

Water Specialties, 6" MW506 Propeller W Flow


Test Only

6

28.2744

Technician

Manny

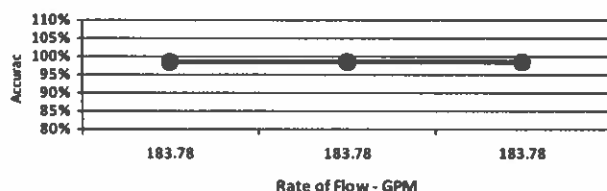

Customer Meter
Average Accuracy

98.60%

Pitot Tube Test Data

Customer Meter

Test No.	Pitot Tube Reading	Actual GPM	Totalizer (start)	Totalizer (end)	Net Volume	Net Volume (gallons)	Test Time (mm:ss:hss)	Measured GPM	Accurac
1	6.5	183.784	160042	160043	1000	1000.00000	05:31:025	181.19	98.59%
2	6.5	183.784	160043	160044	1000	1000.00000	05:31:009	181.24	98.62%
3	6.5	183.784	160044	160045	1000	1000.00000	05:31:021	181.20	98.59%

Additional Information

Test only, no repair or calibration performed.

Approved By:



Test Certification

14812 Hunter Lane
Midway City CA 92655
Phone: 714 450-5929 Fax: 714 829-3103

Serial Number	20030281-6
Test Date	8/4/2022
Record No	1940
P.O. Number	DONNA ANDERSON
Work Order No.	1108

Page 1 of 1

Bill to Customer SE-0070692

Site Customer SE-0059993

Inframark Water Infrastructure Operation
1600 Avalon Parkway
Perris CA 92571

Inframark Water Infrastructure Operations (well #
1600 Avalon Parkway
Perris CA 92571

Flow Meter Totalizer Reading - Gallons

Site Location

Before Test Flow Meter 253995 x 1000

Prover No

well # 2

After Test Flow Meter 253999 x 1000

PT-001

Meter Manufacture Si e and Model

Service Type

Test Cycle

Pipe Diameter

Pipe Area

Water Specialties, 6" MW506 Propeller W Flow


Test Only

6

28.2744

Technician

Manny

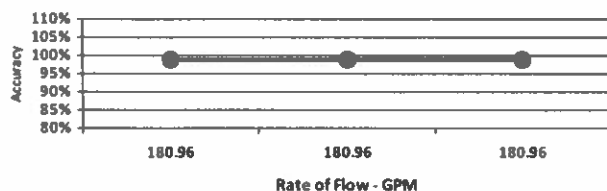

Customer Meter
Average Accuracy

98.96%

Pitot Tube Test Data

Customer Meter

Test No.	Pitot Tube Reading	Actual GPM	Totalizer (start)	Totalizer (end)	Net Volume	Net Volume (gallons)	Test Time (mm:ss:hss)	Measured GPM	Accuracy
1	6.4	180.956	253995	253996	1000	1000.00000	05:35:014	179.06	98.95%
2	6.4	180.956	253996	253997	1000	1000.00000	05:35:001	179.10	98.98%
3	6.4	180.956	253997	253998	1000	1000.00000	05:35:008	179.08	98.96%

Additional Information

Test only, no repair or calibration performed.

Approved By:



Test Certification

14812 Hunter Lane
Midway City CA 92655
Phone: 714 450-5929 Fax: 714 829-3103

Serial Number	20033723-06
Test Date	8/4/2022
Record No	1941
P.O. Number	DONNA ANDERSON
Work Order No.	1108

Page 1 of 1

Bill to Customer	SE-0070692	Site Customer	SE-0030999
------------------	------------	---------------	------------

Inframark Water Infrastructure Operation
1600 Avalon Parkway
Perris CA 92571

Inframark Water Infrastructure Operations (Well)
Corner Of Bradley & Ramona Express
Perris CA 92571

Flow Meter Totalizer Reading - Cubic Feet				Site Location
Before Test	Flow Meter 502369 x 100	Prover No	well # 3	
After Test	Flow Meter 502380 x 100	PT-001	Meter Manufacture Size and Model	
Service Type	Test Cycle	Pipe Diameter	Pipe Area	Water Specialties, 6" MW506 Propeller W Flow
Test Only		6	28.2744	Technician
Accuracy Rate of Flow - GPM				Manny
				Customer Meter Average Accuracy 98.74%

Pitot Tube Test Data			Customer Meter						
Test No.	Pitot Tube Reading	Actual GPM	Totalizer (start)	Totalizer (end)	Net Volume	Net Volume (gallons)	Test Time (mm:ss:hss)	Measured GPM	Accuracy
1	15.5	438.253	502369	502372	300	2244.15584	05:11:025	432.75	98.74%
2	15.5	438.253	502373	502376	300	2244.15584	05:11:017	432.81	98.76%
3	15.5	438.253	502377	502380	300	2244.15584	05:11:032	432.69	98.73%

Additional Information
Test only, no repair or calibration performed.

Approved By




Test Certification

14812 Hunter Lane
Midway City CA 92655
Phone: 714 450-5929 Fax: 714 829-3103

Serial Number	20033724-08
Test Date	8/4/2022
Record No	1938
P.O. Number	DONNA ANDERSON
Work Order No.	1108

Page 1 of 1

Bill to Customer	SE-0070692	Site Customer	SE-0032238
Inframark Water Infrastructure Operation 1600 Avalon Parkway Perris CA 92571		Inframark Water Infrastructure Operations (Well # 4 North Facility Perris CA 92571	

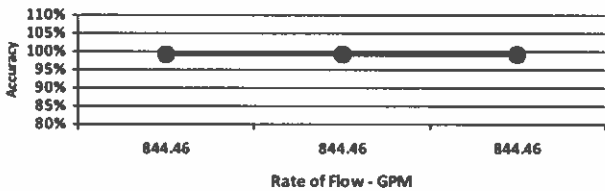Flow Meter Totalizer Reading - Cubic Feet					Site Location
Before Test	Flow Meter 1837893 x 100	Prover No	Well # 4		
After Test	Flow Meter 1837914 x 100	PT-001	Meter Manufacture Size and Model		
Service Type		Test Cycle	Pipe Diameter	Pipe Area	Water Specialties, 8" MW508 Flow com
Test Only			8	50.2656	Technician
					Manny
					Customer Meter Average Accuracy 99.22%

Pitot Tube Test Data			Customer Meter						
Test No.	Pitot Tube Reading	Actual GPM	Totalizer (start)	Totalizer (end)	Net Volume	Net Volume (gallons)	Test Time (mm:ss:hss)	Measured GPM	Accuracy
1	16.8	844.462	1837893	1837899	600	4488.31169	05:21:055	838.08	99.24%
2	16.8	844.462	1837900	1837906	600	4488.31169	05:21:063	837.95	99.23%
3	16.8	844.462	1837907	1837913	600	4488.31169	05:21:079	837.70	99.20%

Additional Information
Test only, no repair or calibration performed.

Approved By:



Test Certification

14812 Hunter Lane
Midway City CA 92655
Phone: 714 450-5929 Fax: 714 829-3103

Serial Number	20022958-4
Test Date	8/4/2022
Record No	1942
P.O. Number	DONNA ANDERSON
Work Order No.	1108

Page 1 of 1

Bill to Customer SE-0070692

Site Customer SE-0079519

Inframark Water Infrastructure Operation
1600 Avalon Parkway
Perris CA 92571

Inframark Water Infrastructure (Booster # 1)
1600 Avalon Parkway
Perris CA 92571

Flow Meter Totalizer Reading - Gallons

Site Location

Before Test Flow Meter 212916 x 100

Prover No

Booster # 1

After Test Flow Meter 212937 x 100

PT-001

Meter Manufacture Size and Model

Service Type

Test Cycle

Pipe Diameter

Pipe Area


Water Specialties, 4" Propeller Meter

Test Only

4

12.5664

Technician

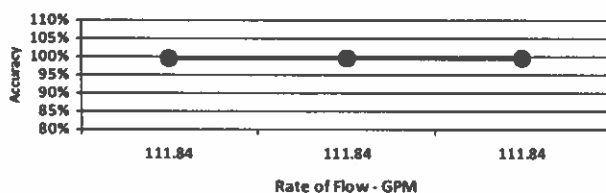

Manny

Customer Meter
Average Accuracy

99.58%

Pitot Tube Test Data

Customer Meter

Test No.	Pitot Tube Reading	Actual GPM	Totalizer (start)	Totalizer (end)	Net Volume	Net Volume (gallons)	Test Time (mm:ss:hss)	Measured GPM	Accuracy
1	8.9	111.841	212916	212922	600	600.00000	05:23:045	111.36	99.57%
2	8.9	111.841	212923	212929	600	600.00000	05:23:041	111.37	99.58%
3	8.9	111.841	212930	212936	600	600.00000	05:23:032	111.39	99.60%

Additional Information

Test only, no repair or calibration performed.

Approved By:



Test Certification

14812 Hunter Lane
Midway City CA 92655
Phone: 714 450-5929 Fax: 714 829-3103


Serial Number	20022955-6
Test Date	8/4/2022
Record No	1943
P.O. Number	DONNA ANDERSON
Work Order No.	1108

Page 1 of 1

Bill to Customer	SE-0070692	Site Customer	SE-0003447
------------------	------------	---------------	------------

Inframark Water Infrastructure Operation
1600 Avalon Parkway
Perris CA 92571

Inframark Water Infrastructure Operations(Boost
1600 Avalon Parkway
Perris CA 92571

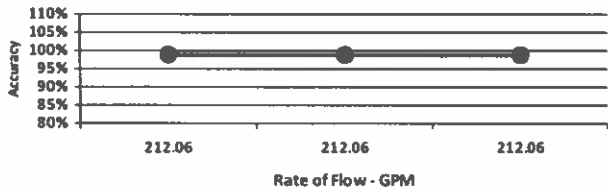Flow Meter Totalizer Reading - Gallons					Site Location
Before Test	Flow Meter 1836037 x 1000			Prover No	Booster # 2
After Test	Flow Meter 1836040 x 1000			PT-001	Meter Manufacture Si e and Model
Service Type		Test Cycle	Pipe Diameter	Pipe Area	Water Specialties, 6" Propeller Meter
Test Only			6	28.2744	Technician
					Manny
					Customer Meter Average Accuracy 98.97%

Pitot Tube Test Data			Customer Meter						
Test No.	Pitot Tube Reading	Actual GPM	Totalizer (start)	Totalizer (end)	Net Volume	Net Volume (gallons)	Test Time (mm:ss:hss)	Measured GPM	Accuracy
1	7.5	212.058	1836037	1836038	1000	1000.00000	04:46:025	209.68	98.88%
2	7.5	212.058	1836038	1836039	1000	1000.00000	04:46:002	209.78	98.93%
3	7.5	212.058	1836039	1836040	1000	1000.00000	04:45:088	210.14	99.09%

Additional Information
Test only, no repair or calibration performed.

Approved By:



Test Certification

14812 Hunter Lane
Midway City CA 92655
Phone: 714 450-5929 Fax: 714 829-3103

Serial Number	20032191-6
Test Date	8/4/2022
Record No	1944
P.O. Number	DONNA ANDERSON
Work Order No.	1108

Page 1 of 1

Bill to Customer	SE-0070692	Site Customer	SE-0078119
Inframark Water Infrastructure Operation 1600 Avalon Parkway Perris CA 92571		Inframark Water Infrastructure Operations (Boost 1600 Avalon Parkway Perris CA 92571	

Flow Meter Totalizer Reading - Gallons				Site Location
Before Test	Flow Meter 1329336 x 1000	Prover No	Booster # 3	
After Test	Flow Meter 1329339 x 1000	PT-001	Meter Manufacture Si e and Model	
Service Type	Test Cycle	Pipe Diameter	Pipe Area	Water Specialties, 6" Propeller Meter
Test Only		6	28.2744	Technician
Accuracy Rate of Flow - GPM				Manny
				Customer Meter Average Accuracy 98.66%

Pitot Tube Test Data			Customer Meter						
Test No.	Pitot Tube Reading	Actual GPM	Totalizer (start)	Totalizer (end)	Net Volume	Net Volume (gallons)	Test Time (mm:ss:hss)	Measured GPM	Accuracy
1	9.9	279.917	1329336	1329337	1000	1000.00000	03:37:045	276.15	98.66%
2	9.9	279.917	1329337	1329338	1000	1000.00000	03:37:040	276.19	98.67%
3	9.9	279.917	1329338	1329339	1000	1000.00000	03:37:046	276.15	98.65%

Additional Information
Test only, no repair or calibration performed.

Approved By:

Manny W. [Signature]



Test Certification

14812 Hunter Lane
Midway City CA 92655
Phone: 714 450-5929 Fax: 714 829-3103

Serial Number	20022837-10
Test Date	8/4/2022
Record No	1945
P.O. Number	DONNA ANDERSON
Work Order No.	1108

Page 1 of 1

Bill to Customer SE-0070692

Site Customer SE-0083497

Inframark Water Infrastructure Operation
1600 Avalon Parkway
Perris CA 92571

Inframark Water Infrastructure Operations (Boost
1600 Avalon Parkway
Perris CA 92571

Flow Meter Totalizer Reading - Gallons

Site Location

Before Test Flow Meter 198722 x 1000

Prover No

Booster # 4

After Test Flow Meter 198728 x 1000

PT-001

Meter Manufacture Size and Model

Service Type

Test Cycle

Pipe Diameter

Pipe Area

Water Specialties, 10" Propeller Meter


Test Only

10

78.54

Technician

Manny

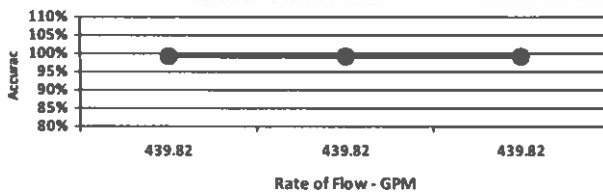

Customer Meter
Average Accuracy

99.15%

Pitot Tube Test Data

Customer Meter

Test No.	Pitot Tube Reading	Actual GPM	Totalizer (start)	Totalizer (end)	Net Volume	Net Volume (gallons)	Test Time (mm:ss:hss)	Measured GPM	Accurac
1	5.6	439.824	189722	189724	2000	2000.00000	04:35:025	436.13	99.16%
2	5.6	439.824	189724	189726	2000	2000.00000	04:35:031	436.07	99.15%
3	5.6	439.824	189726	189728	2000	2000.00000	04:35:031	436.07	99.15%

Additional Information

Test only, no repair or calibration performed.

Approved By:

Manny Moreno