



Test Certification

14812 Hunter Lane
Midway City CA 92655
Phone: 714 450-5929 Fax: 714 829-3103

Serial Number	20030281-6
Test Date	6/15/2020
Record No	1617
P.O. Number	DONNA ANDERSON
Work Order No.	879

Page 1 of 1

Bill to Customer SE-0070692

Site Customer SE-0055383

Inframark Water Infrastructure Operation
1600 Avalon Parkway
Perris CA 92571

Inframark Water (Well # 1)
1600 Avalon Parkway
Perris CA 92571

Flow Meter Totalizer Reading - Gallons

Site Location

Before Test Flow Meter 105355 x 1000

Prover No

Well # 1

After Test Flow Meter 105358 x 1000

PT-001

Meter Manufacture Size and Model

Service Type

Test Cycle

Pipe Diameter

Pipe Area

Water Specialties, 6" MW506 Propeller W Flow


Test Only

6

28.2744

Technician

Manny

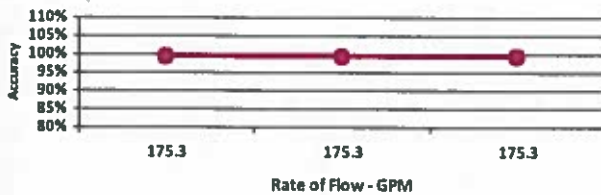

**Customer Meter
Average Accuracy**

99.17%

Pitot Tube Test Data

Customer Meter

Test No.	Pitot Tube Reading	Actual GPM	Totalizer (start)	Totalizer (end)	Net Volume	Net Volume (gallons)	Test Time (mm:ss:hss)	Measured GPM	Accuracy
1	6.2	175.301	105355	105356	1000	1000.00000	05:45:025	173.84	99.17%
2	6.2	175.301	105356	105357	1000	1000.00000	05:45:022	173.85	99.17%
3	6.2	175.301	105357	105358	1000	1000.00000	05:45:025	173.84	99.17%

Additional Information

Test only,
No repair or calibration performed.

Approved By:

Manny M. Lopez