



Test Certification

14812 Hunter Lane
Midway City CA 92655
Phone: 714 450-5929 Fax: 714 829-3103

Serial Number	20033723-06
Test Date	10/29/2019
Record No	1296
P.O. Number	DONNA ANDERSON
Work Order No.	792

Page 1 of 1

Bill to Customer	SE-0070692	Site Customer	SE-0030999
------------------	------------	---------------	------------

Inframark Water Infrastructure Operation
1600 Avalon Parkway
Perris CA 92571


Inframark Water Infrastructure Operations (Well :
Corner Of Bradley & Ramona Express
Perris CA 92571

Flow Meter Totalizer Reading - Cubic Feet

Site Location

Before Test	Flow Meter 298624 x 100	Prover No	well # 3
After Test	Flow Meter 298638 x 100	PT-001	Meter Manufacture Size and Model

Service Type	Test Cycle	Pipe Diameter	Pipe Area	Water Specialties, 6" Propeller Meter
Test Only		6	28.2744	Technician

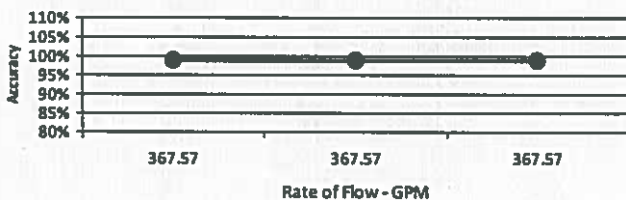

Manny

**Customer Meter
Average Accuracy**

98.86%

Pitot Tube Test Data

Customer Meter

Test No.	Pitot Tube Reading	Actual GPM	Totalizer (start)	Totalizer (end)	Net Volume	Net Volume (gallons)	Test Time (mm:ss:hss)	Measured GPM	Accuracy
1	13	367.567	298624	298628	400	2992.20779	08:14:025	363.32	98.84%
2	13	367.567	298629	298633	400	2992.20779	08:14:011	363.38	98.86%
3	13	367.567	298634	298638	400	2992.20779	08:14:008	363.39	98.86%

Additional Information
Test only, no repair or calibration performed.

Approved By: